

A Major Chemical Company's Journey to Reliability **(a follow-up to their 2005 SMRP paper 'Communication & Accountability** **are the Keys to Success in Condition-Based Maintenance)**

Steve Quillen
Reliability Technology Department
Kingsport, TN

Forrest Pardue
24/7 Systems, Inc.
Louisville, TN

Over the past 20 years, many US plants have invested heavily in condition monitoring technologies such as vibration, oil analysis, thermography, and motor circuit evaluation to provide an accurate prediction of plant equipment problems. These predictive maintenance programs use best of breed technical equipment along with trained and certified analysts, and they often produce solid technical results. Each month valid condition monitoring results are produced and distributed to plant maintenance and operations personnel. So why do critical machines that have been identified as degraded in advance of continue to fail in service? Why do many predictive maintenance programs have their funding and staff cut at the first sign of a sales decline?

The problem is actually that plant management implemented condition monitoring without laying the groundwork for Condition-Based Maintenance. What's the difference? Condition monitoring is largely a technology and training issue while Condition-Based Maintenance requires the existence of a reliability culture involving both operations and maintenance. Innovative plants such as this major chemicals site have found that a consistent program of communication and accountability have helped them to instill and sustain that type of Condition-Based Maintenance culture.

Creating a Condition-Based Maintenance Plant Culture

Typically, top management sets a Condition-Based Maintenance vision:

"Our plant will...

- Eliminate in service failures on critical equipment,
- Eliminate costly preventive (scheduled) maintenance work when condition analysis shows no need for the work,
- Eliminate basic machinery problems so that less total maintenance is required,
- Extend the life (reliability) of plant equipment while achieving the lowest total lifecycle cost, and
- Measure program results and adjust resources and focus as needed.

The plant then proceeds to either buy monitoring equipment and train personnel, or hire predictive maintenance contractors. So the plant must be doing Condition-Based Maintenance... Right?

Not really – Condition-Based Maintenance is far more than conducting condition monitoring activities and developing technical proficiency with the tools. Those steps are necessary, but so is the need for upper management to instill a mindset that equipment reliability is the shared responsibility of operations and maintenance. Until that shared attitude is made an integral part of plant culture, the reliability improvement initiative is fragile and prone to cutbacks, inattention, and failure. Therefore, top management's responsibility must go beyond 'setting the vision' and 'acquiring monitoring technology' to include:

- Creating an effective system for communicating machinery health status
- Holding plant employees accountable for follow-up actions & results

Communicating Machinery Health Status Effectively

In too many plants poor communication leads to wasted effort by the condition monitoring teams. Condition monitoring results are produced by multiple monitoring technologies, each using a different database and analysis software. This is inevitable as the plant strives to match the best system for a specific technology with the plant's needs, or to select the best PDM contractor for certain technologies. Unfortunately, different technicians using dissimilar systems create reports with different formats and terminologies. These are usually dispersed among a various people in different departments based on the technology, and quickly secluded in report binders and long e-mail lists. This piecemeal communication makes it difficult for a broad audience of maintenance and operations personnel to be aware of all known information about a specific asset's health.

For example, a major chemical manufacturer's plant in Tennessee plant is a large, multi-product facility with over 20,000 rotating machinery trains. The plant began performing predictive maintenance in the mid-1980's and developed a predictive maintenance group using multiple technologies such as:

- Vibration Monitoring (Route and Online)
- Infrared Thermography
- Lubrication Analysis
- Ultrasonic Monitoring
- Motor Analysis

By the mid 1990's, this predictive maintenance group was well respected for it's technical proficiency, and was credited with preventing a significant number of production interruptions by catching equipment problems prior to failure. However, several people within plant management felt there was room to improve.

First, they realized that the organization was handling condition information as shown in Figure 1.

Individual condition reports from different technologies were going to different maintenance contacts for an operations area. These contacts would usually have to negotiate with their operations counterpart over the need for and scheduling of repair activity, before being able to forward a request to the maintenance planner. This resulted in delays and "dropped balls" in handling equipment problems in a Condition-Based Maintenance manner. The key issues leading to this result were:

- Few people, if anyone, had a complete picture of all known condition issues on a piece of equipment,
- Operations had very little 'buy-in' to the concept of Condition-Based Maintenance,
- The first notice maintenance managers had about 'dropped balls' was usually a call from operations, after the fact.


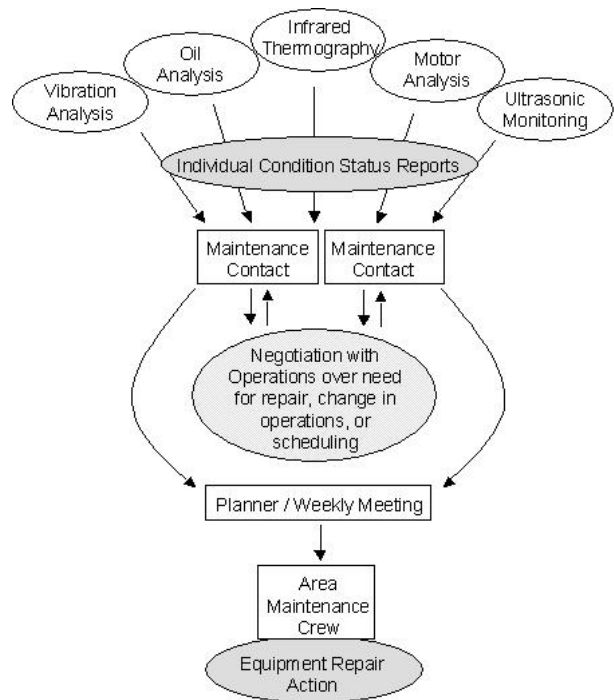


Figure 1: Old flow of condition based work

In the late 1990's the decision was made to modify organizational structure and information flow to improve use of equipment condition information and better support a Condition-Based Maintenance mindset.

Figure 2: Modified flow of condition based work

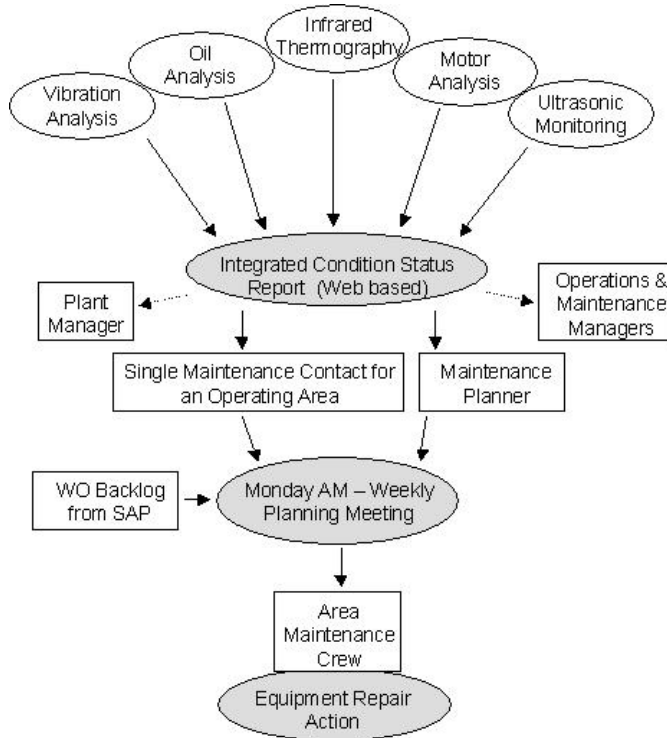

The organization structure was modified as shown in Figure 2. The key change was assigning a single maintenance contact to each operating area; this contact is the liaison between the predictive maintenance group and operations. They work with operations to evaluate potential equipment problems and scheduling options for maintenance action, and are ultimately responsible for ensuring that timely maintenance action takes place.

Following the organization change it was also decided that an integrated condition status report was needed to merge findings and recommendations from each of the technologies being used to monitor a problem machine. High priority was put on making the integrated condition results easily available to a wide audience of operations, maintenance, and executive managers. The report had to be asset based rather than monitoring technology based, and it also needed to be accessible

without requiring installation of special software by users. That led to creation of a web-based Integrated Condition Status Report system.

With the new organization and Integrated Condition Status Report in place, the semi-monthly planning meeting became focal point for joint responsibility of equipment reliability. Everyone involved, including predictive maintenance analysts, planner, and area operations and maintenance managers, now have access to the same equipment health status information before and while in the meeting. Issues can't be swept under the table or ignored, and the group is able to spend their time focusing on operations scheduling and work order priorities for maintenance action.

There were several communications issues that had to be tackled in the evolution from technology focused reporting to asset-centered communication of condition monitoring results:

- 1) Integration of health status information from multiple technologies
- 2) Standardization of reporting format and terminology
- 3) Distribution of findings, recommendations, and work status to a broad base of plant personnel

1) Integrating Condition Status in a Web-hosted database

The piecemeal communication described in the old organization is technology-centered, both in report generation and in who receives the reports. Integrating condition results from all technologies under each specific machine location is the first step toward asset-centered communication of health status. Web-hosted database technology offers a solution for asset centered integration. Condition results can be collected in a single web-hosted database, independent from the proprietary databases housing the technical data. In-plant technicians and outside PDM contractors enter plain language findings and recommendations into this web-hosted database via the Internet, bypassing any issues about outside vendors having to cross security firewalls in the plant network. Authorized plant users login via a web browser to retrieve a health report for their area of the plant, without having to install and maintain any special software. Machines with severe health problems are marked with a red light at the top of the list. This plant uses an asset-centered health status report as seen in Figure 3 to graphically communicate which machines have significant health issues based on all the monitoring technologies being applied to that machine.

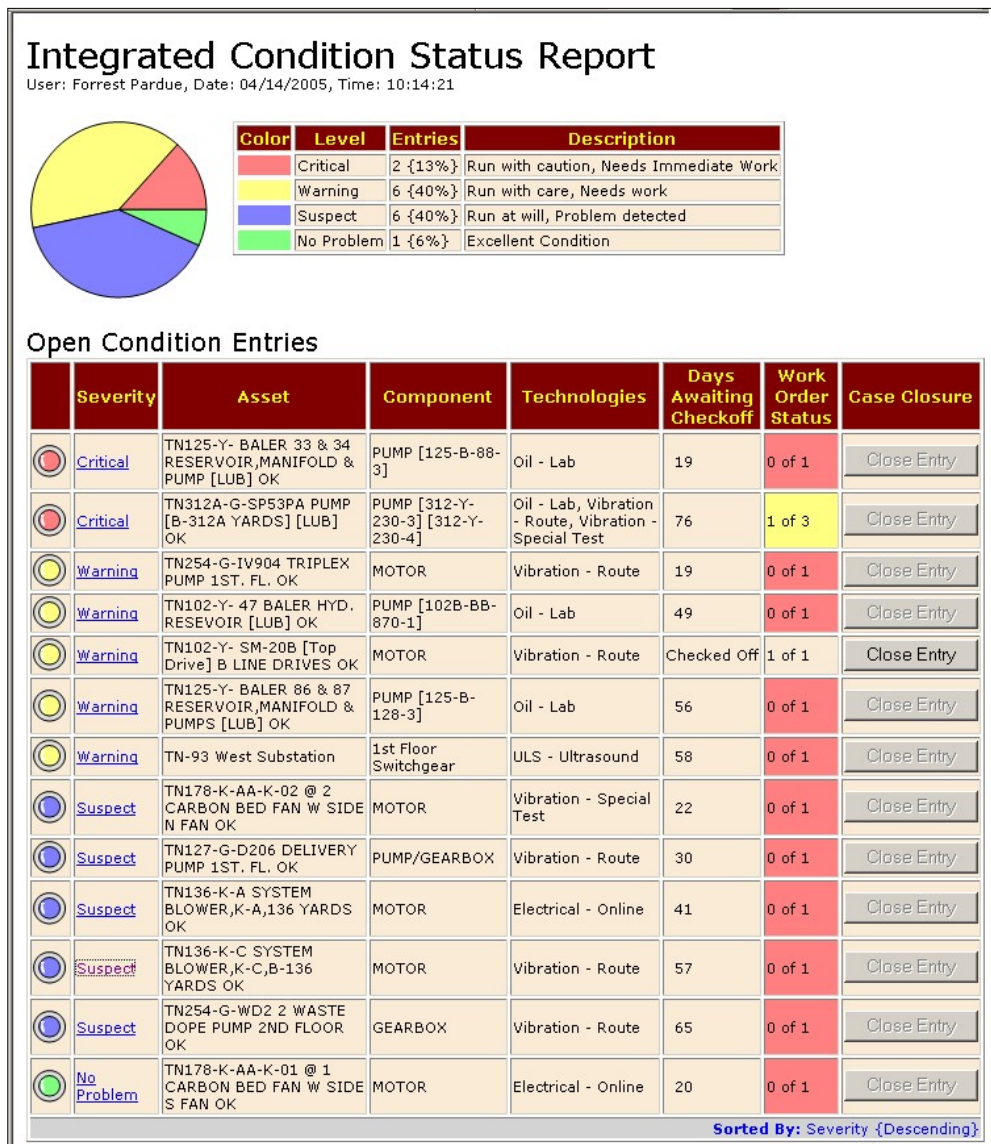



Figure 3: Multiple technology results integrated for each asset location

Planners, supervisors, and plant managers can see what may affect operations, then drill down for more detail to support their daily decisions (Figure 4). If they are interested in the technical data behind the analyst's recommendations, they can open linked documents to view the supporting information.

Location Technology Condition Status Report

User: Forrest Pardue, Date: 10/14/2005, Time: 12:12:54

Location:
*Voridian (Acetate Fibers) >> B-312 TANK FARM >> TN312A-G-SP53PA PUMP [B-312A YARDS]
 [LUB] OK >> PUMP [312-Y-230-3] [312-Y-230-4]*

 [Location Condition History Report](#)

Entry	Severity	Type	Faults
04/19/2005 (6 Days) <i>Bv: Wade</i>	Suspect	Technology Condition Entry <i>Vibration - Route</i>	<ul style="list-style-type: none"> Pump surge Restrictive flow
<i>Recommendations:</i> Check for cavation Check for vanepass Check for flow turbulence <i>Comments:</i> Yard #312 Tank Farm Pump SP53 PA, Vibration has trended up on pump. During start up pump seems to be surging as if it is under a Load. Recommend inspecting check valves for wear or damage. All so check piping and automatic valves for proper functioning. Repair as needed.			
<i>Linked Documents</i> None			
<i>Work Order Request:</i> Add <i>Work Order Number:</i> Add			
<input type="button" value="Check Off"/>			
02/10/2005 (74 Days) <i>Bv: Brenda</i>	Critical	Technology Condition Entry <i>Oil - Lab</i>	<ul style="list-style-type: none"> Lubrication Contamination
<i>Recommendations:</i> Oil Change <i>Comments:</i> Excessive Particle Count- High Iron (329 PPM) This is for 312-Y-230-3.			
<i>Linked Documents</i> Oil Lab Report			
<i>Work Order Request:</i> Add <i>Work Order Number:</i> Add			
<i>Checked Off:</i> 02/11/2005 <i>Comments:</i> Oil Changed 2/11/05.			
02/08/2005 (76 Days) <i>Bv: Wade</i>	Warning	Technology Condition Entry <i>Vibration - Special Test</i>	<ul style="list-style-type: none"> Bad Bearing
<i>Recommendations:</i> Replace Pump <i>Comments:</i> Pump has bad bearings. Replace/repair pump.			
<i>Linked Documents</i> None			
<i>Work Order Request:</i> Add <i>Work Order Number:</i> 050415-27			
<i>Checked Off:</i> 04/19/2005, <i>Comments:</i> Pump replaced with new unit.			

Figure 4: Drilling down to detailed recommendations & supporting documents

Once planners have generated a work order they can enter a reference number to the condition entry, so anyone who wants to check into work order progress knows where to look it up in the plant's SAP system. Once a work order reference has been entered the Integrated Condition Status Report also shows how many days the oldest work order for an asset has been open. When the work is complete, the planner can also notify others by 'Checking Off' the condition entry. When that is done, then the Integrated status report also shows a 'Close Entry' button for that condition case, as seen in Figure 3. The predictive maintenance technician responsible for that entry can then close the case and remove it from the report, in many cases after a follow-up monitoring session to confirm that the problem has been resolved.

Therefore, participants in the weekly planning meeting not only see condition status for problem machines, but they also get a snapshot of response and work status for those health issues. That keeps all departments informed on progress; such broad exposure of Condition-Based Maintenance status also makes it a lot harder to hide shortcomings.

2) Standardization to Improve Understanding of Information

Just as in human medicine, it is very important that all parties use common terminology when describing machinery health issues. Standardization of condition results mean that everyone inputting findings and recommendations use common equipment location names, faults, and severity levels, and that the output information has a standard look and content regardless of technology, analyst, or whether they're plant employees or an outside contractor.

Once again a single web-hosted database can provide a results entry form (Figure 5) that uses pull down lists to enforce standardized terminology. This screen utilizes a standard pull down list for the selection of faults, recommendations and severity. The pull down lists also enforce brevity to make the information easier to understand; an analyst can also write a more comprehensive problem description if needed. Such standardization allows a common look and language between condition technologies, and it also facilitates future mining of the information for common patterns. This simple mechanism for standardizing basic findings and recommendation content does not exclude technical reporting, as supporting data images and documents can be linked to the condition entry, for retrieval by interested users.

The diagram illustrates the flow of data from various condition technologies into a standardized entry form. At the top, six boxes represent the technologies: Oil, Thermography, Vibration, Electrical, Ultrasonics, and Process. Arrows from each box point down to a central window titled "Condition Technology Entry".

The "Condition Technology Entry" window is a web-based form with the following sections:

- Suspected Faults:** A table with columns "Fault Type" and "Fault Class".

Fault Type	Fault Class
Current Imbalance	Electrical - AC
Impedance Imbalance	Electrical - AC
Voltage Imbalance	Electrical - AC
- Recommended Action:** A text area containing "Check Power Source".
- Info:** A section with tabs for "Comments", "Linked Docs", and "Checkoff Info". It contains several fields:
 - Technology: MCE (dropdown)
 - Est. Availability: 0 Days
 - Analyst: Forrest Pardue (dropdown)
 - Next Planned Inspection: 9/22/2003 (calendar)
 - Severity: High (Action needed within 30 days) (dropdown)
 - Entry Date: 9/22/2003 (calendar)
 - Work Request: (text field)
 - Work Order: auto (text field)

Buttons for "OK", "Cancel", "Location Info", and "Plugins" are located on the right side of the form.

Figure 5: Standard condition results form

3) Distribution to a Broad Plant Audience via Web-browser

Something amazing happens in human organizations when people know that information about their area of responsibility is widely available to others. They care more about what's happening and tend to focus their energy on doing a better job. This applies to executives as well as managers, engineers, and craftsmen.

Web-browser technology is well suited for allowing a broad base of users to access equipment health information with minimum effort, while still providing some control over what each individual user can view or interact with. Practically all computers have an Internet browser installed, so there's no need to install

and maintain specialized software. They only need the correct URL for their web-hosted database, along with an authorized user name and password, to see the current health status of equipment in their area of concern.

One of the Reliability Engineers at the site credits the wide and persistent visibility of condition results as one of the keys in making operations and maintenance joint owners of equipment reliability. He says that “prompt response to resolve condition-based maintenance issues” has become the way of life because everyone knows that “the bosses care”.

Accountability for Results


Good communication of condition status may be essential for guiding work prioritization, but that alone does not mean that the best Condition-Based Maintenance results are being delivered to the plant business. Personnel must be held accountable for using the information to produce increased reliability results. Two important execution measurements for Condition-Based Maintenance are:

- 1) If equipment does show health issues, are timely maintenance responses happening?
- 2) Is condition history being kept and analyzed to spot & address chronic reliability issues?

As has been said many times - “What gets measured gets done!”

In addition to the work response measures available in the Integrated Condition Status Report, they have taken advantage of a single database with integrated condition results and work follow-up status to generate several custom reports. One of these trends the timeframe in which condition-based work orders are resolved; the report can be set to cover all condition-based activity or a single technology in a specific operations area. Figure 6 shows that over 90% of work requests generated by vibration monitoring during the first nine months of 2004 had been addressed and resolved.

Figure 6:
Customized
maintenance
follow-up
report for
condition-
based work
orders

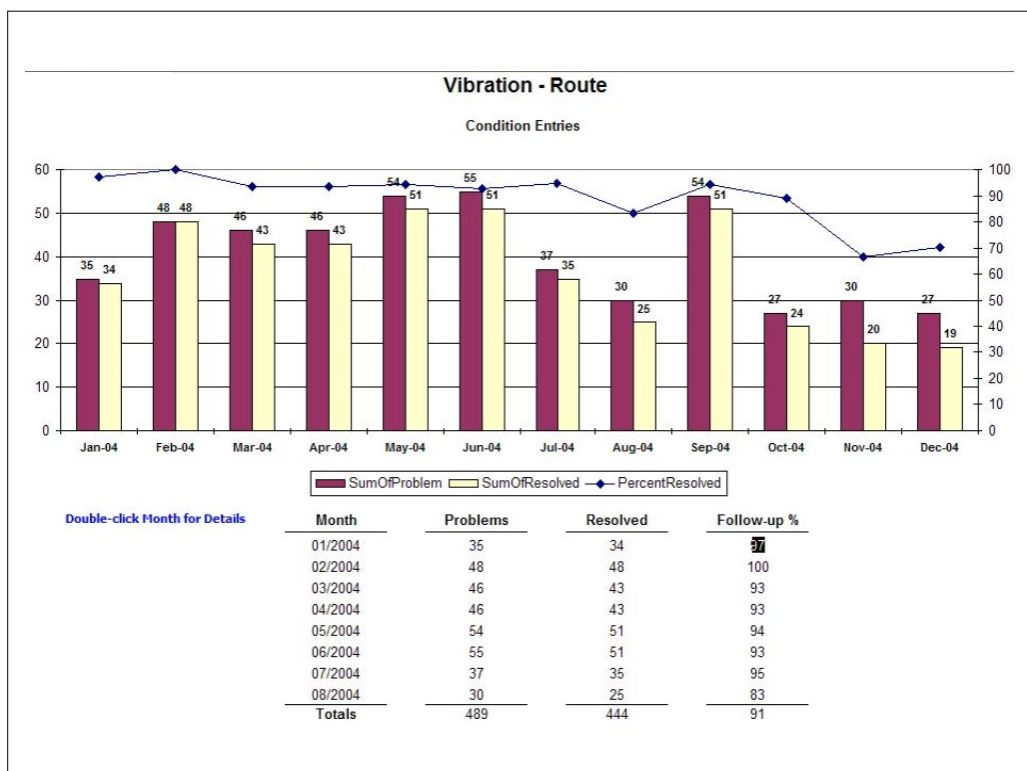

Their Reliability Technology Report (RTP) for vibration monitoring is shown in Figure 7. It tracks resolution of condition-based work requests and is available to area managers for more detail on how well their crews are utilizing information from a specific predictive technology. It shows area operations and maintenance managers how condition generated work orders were handled during the month, and how their area compared to others. Area managers typically focus on the Year To Date '% Corrected' table at the bottom and ask 'what do we have to do to get better?' Predictive maintenance technicians also review these reports to understand which areas may need additional help in using their information.

Figure 7: Customized maintenance follow-up report by individual monitoring technology

Reliability Technology Department

Vibration Monitoring - Monthly Report

User Name GK Thursday, May 12, 2005

Area CE&SP Month April Year 2005

Vibration Index this month 0.14 Vibration Index All TED 0.101

449 Machines in Database

241 Machines Monitored This Month

4 Problems Documented This Month 29 Documented YTD

4 Problems Known Corrected This Month 13 Corrected YTD

3 Problems Outstanding This Month 20 Outstanding YTD

Job Sheet Data * May Include Prior Year Jobs

CE&SP	Reported This Month	Reported Y. T. D.	Corrected This Month *	Corrected Y. T. D. *	Corrected This Year
	1	1			0
B- 51 CR. 4210	0	1	0	1	0
B- 65 CR. 4227	1	1			0
B- 81 CR. 4204	0	4	0	1	1
B- 81 CR. 4211	2	7	0	1	1
B-120 CR. 4207	0	2	0	1	1
B-120 CR. 4208	0	10	4	9	3
B-190 CR. 4228	0	3	0	0	0


Year To Date Percentages * May Include Prior Year Jobs

Unit Name	Finds	Follow ups *	Percent *
CE (Acid Con)	8	2	25.0%
CE (CPE-EST)	12	10	83.3%
CE (Film)	4	1	25.0%
CE (Plastics)	5	0	0.0%
Totals	29	13	44.8%

Use of Historical Condition Information

The plant's condition monitoring analysts and reliability engineers are also able to receive custom reports that help them identify chronic failure issues. In a 'Faults by Component' report, the user selects plant areas, time frame, and monitoring technologies; the example shown in Figure 8 covers all technologies being used across several operating areas for 2005 YTD (through June 2005). Reduction gearboxes quickly stand out with the highest number of faults. Drilling into the report would uncover filter design and lubrication issues that are the greatest common denominators behind the gearbox faults; providing important information for targeting reliability improvement initiatives. For example, over the last several years this plant has significantly reduced chronic equipment problems such as imbalance, misalignment, lubrication, and installation issues by using historical failure mode information to change procedures and justify special training and tools.

Figure 8: Customized report for number of faults by equipment type, 2005 YTD

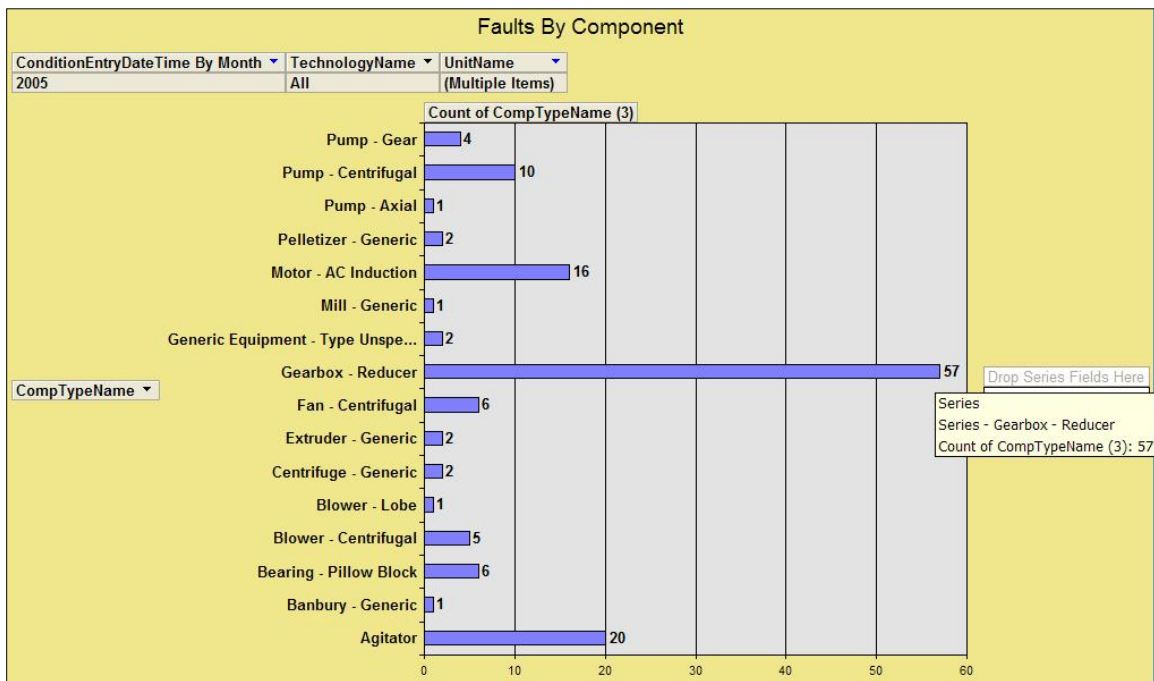

They have also been able to use historical condition information to fine-tune its condition monitoring activities. When a condition monitoring 'find' is defined as leading to a maintenance or repair action, it is generally accepted that condition monitoring programs at industrial plants typically progress according to the trend shown in Figure 9:

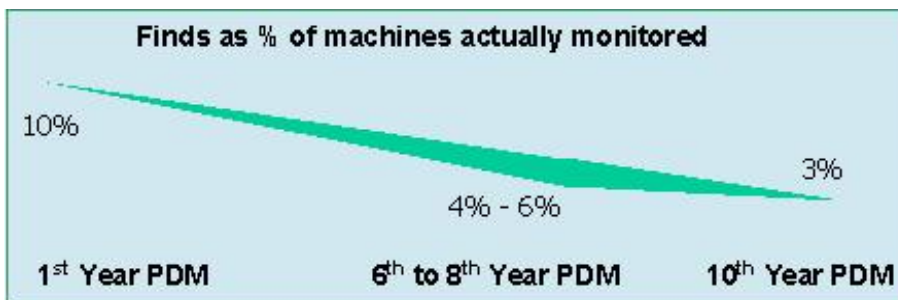


Figure 9: Typical 'Find %' as PDM Program Matures

A Reliability Engineer used the historical information to calculate their 'find %' and found that they were at the 4% level in the mid-90's and reached 2 ½% around 2003. It's probably not a coincidence that the improvement in reliability culture was occurring at the same time. Management's confidence in Condition-Based Maintenance execution helped decide to reduce vibration monitoring frequency for less critical equipment from monthly to every other month or even quarterly. They were then able to shift some manpower from routine monitoring to higher value added root cause analysis activities. It's also probably not a coincidence that over the same time period the plant's wrench-turning maintenance force has decreased from approximately 1200 employees to around 800, while production capacity has slightly increased.

In Summary (as of 2005 that is):

At this major chemical producer management's vision for Condition Based-Maintenance and equipment reliability has really been embedded in most of the plant's culture:

- Operating area 'bosses' know and care about what's happening with equipment reliability because they can view current Integrated Condition Status and work response via their web-browsers.
- A weekly planning meeting is the focal point where operations and maintenance work together to prioritize work based on condition status - to the point that condition surveys conducted on Friday are expected to be entered and responded to in time for the Monday am planning session! That's culture change!
- Accountability is consistently based on condition status and work execution rather than informal complaints from operations.
- Condition history is being used to spot chronic equipment problems and focus reliability improvement resources, as well as fine-tune the monitoring activity.

One of the significant contributors to this plant's Condition-Based Maintenance success is their single database for housing all equipment condition status and web-based distribution of information from that database.

Reliability Update – 2016: Where is this plant now on their Reliability Journey?

This plant started implementation of predictive maintenance technologies in the mid-1980's.

One of their reliability engineers presented a white paper in 1999 reporting good technical proficiency of these technologies, but also highlighting the reality that inconsistent communication of condition-based information was limiting their success in improving equipment reliability.

The 2005 paper reviewed above documents the results achieved within the first five years of changing organization structure and implementing a web-based Reliability Information Management System to address these communication issues at the plant.

Now it's more than 10 years past that paper and nearly sixteen years from the changes made to improve the impact of condition-monitoring on equipment reliability. Unlike many other plants who have had reliability programs (and reliability champions) come and go with every change in plant managers, this chemical company's asset reliability program is still very much a part of the maintenance, operations and management culture.

This long history of asset reliability management allows us to explore several questions.

1. Why has this plant's reliability program been successful and sustainable during the same time period that many other corporate programs have been implemented, shown success, but then declined?


Plant management at this site has a strong maintenance background. The current plant manager ascended through the maintenance department. Managers across Operations, Maintenance, and Reliability keep informed on the status of open condition problems in their area through the browser based dashboard.

Their teams use that information in semi-monthly review meetings to plan maintenance schedules and resources. One reliability engineer credits the wide and persistent visibility of condition results as a key in making operations and maintenance joint owners of equipment reliability. He says that, "Prompt response to resolve condition based maintenance issues has become a way of life because everyone knows the bosses can see what's happening, and that they care."

In short, their plant culture now embraces asset reliability for the long run.

2. How did improved communication of reliability information drive this change in plant culture?

Improved communications helped create ownership and accountability for timely follow-up of problems identified through condition monitoring. When condition case closure times spiked at random times 2006 and 2014, the reliability information system documented these spikes and lead to a renewed effort to drive closure times down over the last two years.

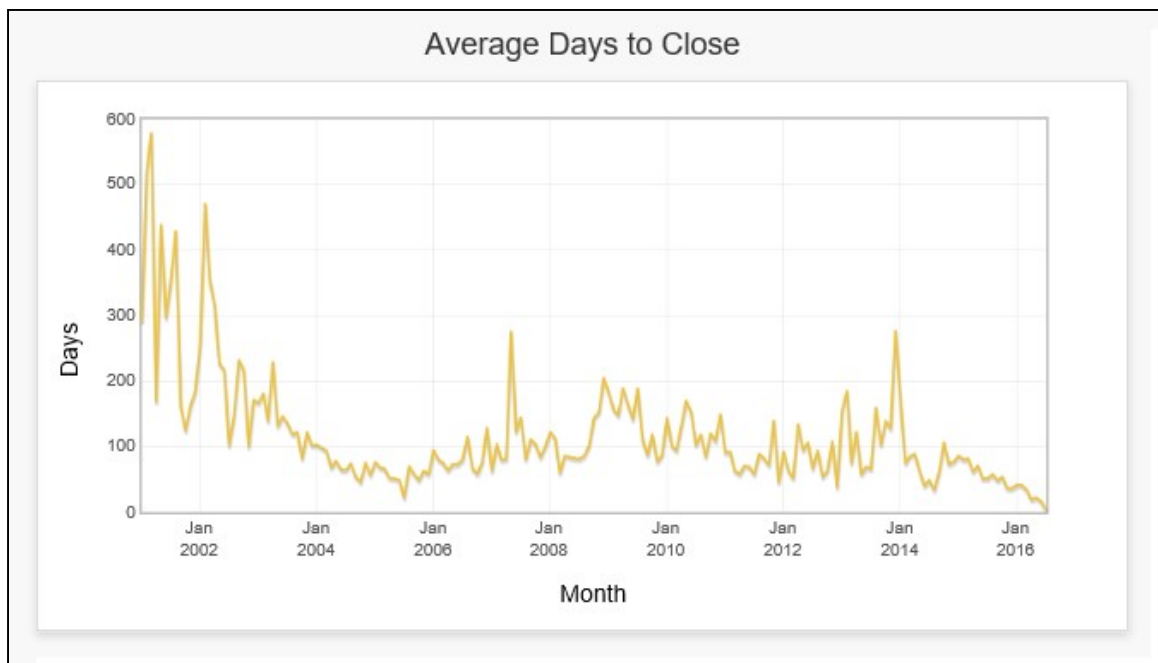

According to one reliability engineer at the plant, "A big change occurred when the reliability information system started providing automatic emails as soon as a condition problem was identified, changed, checked off or closed. This email notification ensured that condition information was promptly getting to the right people at the right time. The

method also ensured that when an employee moved or changed jobs, notification happened to the plant system administrator regarding the change. The system allows the replacement's email to be added for seamless continual communication.”

From: tango@mg.tf7.com [<mailto:tango@mg.tf7.com>]
Sent: Thursday, July 21, 2016 7:31 AM
To: parduef@tf7.com; squ@man.com
Subject: Technology Condition Entry: Updated to Closed

Technology Condition Entry
 CE CPE-EST » B-303 PUMPS, FANS, CENT. AGIT. PULVERIZER » TN303-K- SC2-K-AD30
 FAN, VENT ,FL.4 MIDDLE ON GRATING [RBM60] 2PTS AMI 3 » MOTOR
[Log into Tango Webservice](#)

Condition Entry Details

Technology Vibration - Route
 Analyst John
 Severity Suspect {WO D or S (Problem Detected)}
 Entry Date May 19, 2016

Suspected Faults

Fault	Fault Group
Unbalance	Mechanical

Recommended Action
 Clean Fan

Comments
 Vibration levels have reached .416 in/sec on the inboard fan bearing. 1X of the run speed is dominant. This is an indication of unbalance. Recommend cleaning the fan; check for any loose components on the fan/motor.

Checkoff Status

Checkoff Date Jul 20, 2016
 Checkoff User u798
 Checkoff Comment Waiting on further evaluations

Close Status

Close Date Jul 21, 2016
 Close User John




Figure 10 – Email notification that a condition-based case has been closed

3. How has the historical analysis of faults benefitted the plant?

“We began measuring usage and effectiveness of the program very early on” says the reliability engineer. “We measured number of finds, and the type of find and number of days to resolve were the 2 main measures in the beginning. The number of ‘Finds’ over 16 years have decreased even though more equipment has been added along the way. We feel that this has been achieved partially due to fact that equipment history is readily available and enables us to find and correct “Bad Actors.”

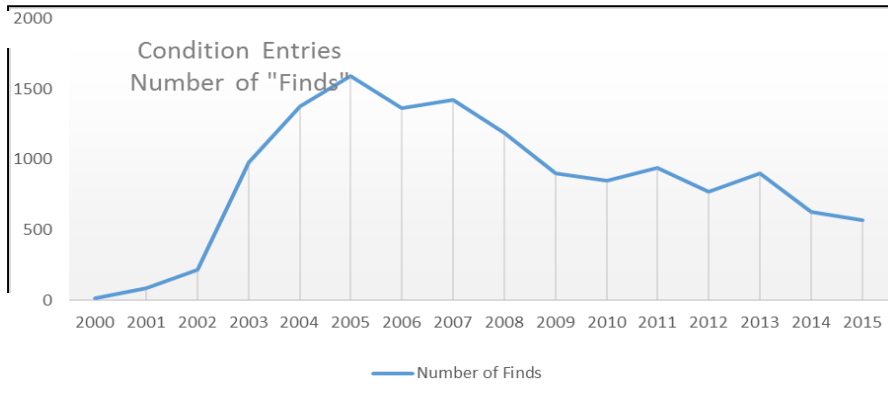


Figure 11 – Trend of total condition-based 'Finds'

This has also helped in identifying some training needs, such as alignment training, bearing installation, and proper belt alignment and tensioning. These were identified in the Vibration finds trend - as you can see in 2004 these types of finds peaked out."

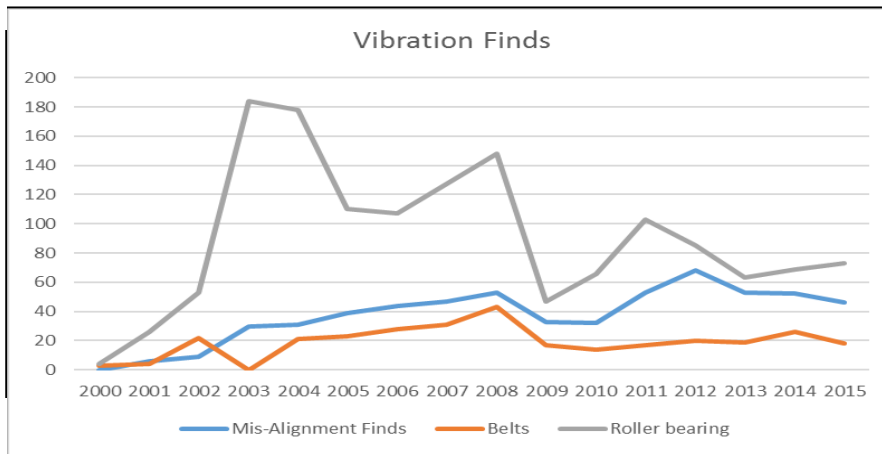


Figure 12 – Trend of vibration condition-based 'Finds' by equipment type

Our Lubrication Analysis identified improper Lubrication storage in certain areas and the trend charts clearly show that corrective actions have made a huge impact on Lubrication type findings."

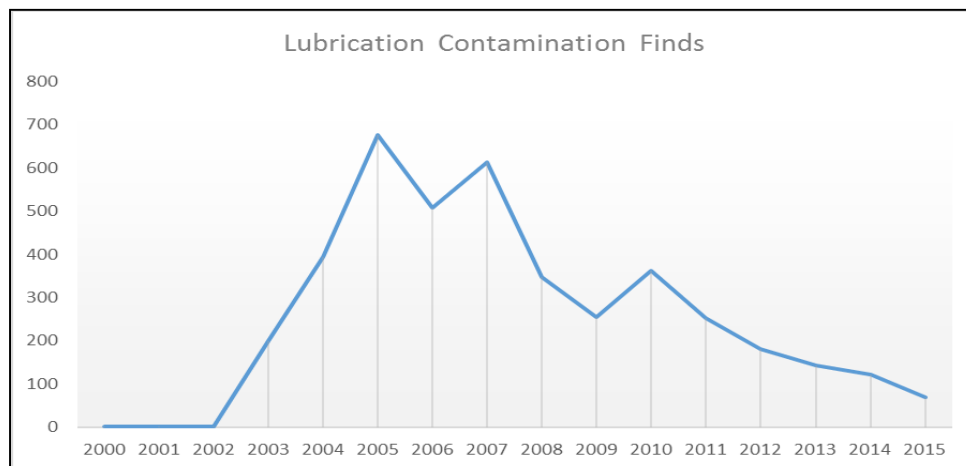


Figure 13 – Trend of contaminated lubricant 'Finds'

And that's how a focus on broad communication of equipment condition information and status of follow-up action has created the visibility and accountability to create management support needed to keep this plant's Reliability program in place and improving for nearly three decades – and counting.

KEYWORDS:

Asset Reliability
Best Practices
Culture Change
Condition Monitoring
Equipment Reliability
Lessons Learned
Maintenance Process
PdM
Planning and Scheduling
Reliability
Work Order